

TFC54F3Y1



Features:

- Selectable 2 pipe or 4 pipe system
- Selectable control mode
- Selectable fan speed contact
- Selectable Fahrenheit or Celsius scale
- Manual Night Set Back override (programmable)
- Multi level lockable access menu
- Lockable Set point
- Selectable internal or external temperature sensor
- Selectable proportional control band and dead band
- Change over by contact or external temperature sensor available

Technical Data

| TFC54F3Y1 | |
|--|--|
| Outputs | 2 triac outputs 3 digital outputs (fan) |
| Contact rating | Resistive load: rated load: 1.0 Amp / 24 Vac/Vdc Inductive load: rated load: 0.3 Amp / 24 Vac/Vdc maximum switching capacity: 30 VA / 24 W |
| Triac rating | 0.3 Amp @ 24 Vac (8 VA) |
| Power supply | 22 to 26 Vac 50/60Hz |
| Power consumption | 1 VA |
| Set point range | 10°C to 35°C [50°F to 95°F] |
| Display resolution | ±0.1°C [0.2°F] |
| Control accuracy | Temperature: ±0.5°C [0.9°F] @ 22°C [71.6°F] typical calibrated |
| Proportional band | 0.5 °C to 5°C [1 °C to 10°F] adjustable |
| External sensor thermistor | Type G, 0°C [32°F] = 29.49 kΩ, 25°C [77°F] = 10 kΩ, 50°C [122°F] = 3.893 kΩ, |
| Electrical connection | 0.8 mm ² [18 AWG] minimum |
| Operating temperature | 0°C to 50°C [32°F to 122°F] |
| Storage temperature | -30°C to 50°C [-22°F to 122°F] |
| Relative Humidity | 5 to 95 % non condensing |
| Degree of protection of housing | IP 30 to EN 60529 |
| Weight | 80 g. [0.18 lb] |

Presentation

| Symbols on display | | | |
|---------------------------|---|----------------|--|
| | Cooling ON 100% output A: Automatic | | Menu set-up Lock ON |
| | Heating ON 100% output A: Automatic | | Programming mode (Technician setting) |
| | Fan ON 3 rd speeds activated A: Automatic | MIN MAX | Minimum/Maximum set points |
| | °C: Celsius scale °F: Fahrenheit scale | | Energy saving mode ON |

Dimensions

| | | |
|------------------|----------------------|--------------------|
| | | |
| Dimension | Imperial (in) | Metric (mm) |
| A | 3.00 | 78 |
| B | 3.00 | 78 |
| C | 1.00 | 24 |
| D | 2.36 | 60 |

Mounting Instructions

CAUTION: Risk of malfunction. Remove power prior to separate thermostat cover from its base.

- Remove the screw (captive) holding the base and the front cover of the thermostat.
- Lift the front cover of the thermostat to separate it from the base.
- Pull wire through the base hole.
- Secure the base to the wall using wall anchors and screws (supplied). Make the appropriate connections.
- Mount the control module on the base and secure using the screw.

Terminal description



| Terminals | 2 Pipe | | | 4 Pipe | | | |
|-----------|------------------------|-------------------------------------|------|--------|-----------------------------|------|--------|
| | Fan option | 1 spd | 2spd | 3spd | 1 spd | 2spd | 3spd |
| 1 | Common (COM) | Common | | | | | |
| 2 | 24 Vac (24VAC) | 24 Vac | | | | | |
| 3 | Sensor (EXT. TS) | Change over temp. sensor or contact | | | External temperature sensor | | |
| 4 | NSB input (NSB. INP) | Night set back input | | | | | |
| 5 | Triac output 1 (TO1) | Cool/Heat | | | Heat | | |
| 6 | Triac output 2 (TO2) | Reheat | | | Cool | | |
| 7 | Digital output 1 (DO1) | - | - | High | - | - | High |
| 8 | Digital output 2 (DO2) | - | High | Medium | - | High | Medium |
| 9 | Digital output 3 (DO3) | 1 speed | Low | Low | 1 speed | Low | Low |

Settings on PC Board

| | |
|---|--|
| <p>Mode Selection (JP1)</p> <p>JP1 RUN PGM</p> | <p>Jumper (JP1) on RUN: Thermostat is in Operation Mode. Thermostat must be set in this mode to operate properly. If not locked, set point, control mode and speed fan (Heating & Cooling ON, Cooling only ON or Heating only ON) may be modified by end user.</p> |
| <p>JP1 RUN PGM</p> | <p>Jumper (JP1) on PGM: Thermostat is set in Programming Mode. Refer to following section about all settings description</p> |
| <p>Digital output signal selection (JP2)</p> <p>JP2 24VAC COM</p> | <p>Jumper (JP2) on 24VAC: All digital output signal is linked to 24 Vac.</p> |
| <p>JP2 24VAC COM</p> | <p>Jumper (JP2) on COM: All digital output signal is linked to common.</p> |

Programming Mode

When in this mode this symbol  is displayed. Please press on button  to advance to the next program function, press on button  to return to preceding stage and press on button  or  to change value. You can leave the programming mode at any time, changed values will be recorded.

| Step | Display | Description | Values |
|------|---|---|--|
| 1 |  | Internal temperature sensor Calibration: Display switches between "tS1" and temperature read by internal temperature sensor. You can adjust the calibration of the sensor by comparison with a known thermometer. For example if thermostat has been installed in an area where temperature is slightly different than the room typical temperature (thermostat place right under the air diffuser). |  Range: 10 to 40°C [50 to 104°F] (max offset ± 5°C) Increment: 0.1°C [0.2°F] |
| 2 |  | Minimum set point: Display switches between "Stp" and the minimum set point temperature. MIN symbol is also displayed. Please select the desired minimum set point temperature. The minimum value is restricted by the maximum value (step #3) |  Minimum range 10 to 35°C [50 to 95°F] Increment: 0.5°C [1°F] Default value: 15°C [59°F] |
| 3 |  | Maximum set point Display switches between "Stp" and the maximum set point temperature. MAX symbol is also displayed. Please select the desired maximum set point temperature. The maximum value is restricted by the minimum value (step #2) |  Maximum range 10 to 35°C [50 to 95°F] Increment: 0.5°C [1°F] Default value: 30°C [86°F] |
| 4 |  | Locking the set point: Display switches between "LOc" and "Stp". You can lock or unlock the set point adjustment by end user. If locked the lock symbol will appear. |  Default value: Unlocked |
| 5 |  | Locking the set point (cont'd): Select the desired locked set point temperature; this one should be within the temperature range. | Set point range: 10 to 35°C [50 to 95°F] Increment: 0.5°C [1°F] Default value: 22°C [72°F] |
| 6 |  | Adjust the control mode: Display switches between "CtL" and "Aut". Select which control mode you want to authorize: Automatic, cooling or heating, heating only or cooling only. If you want to authorize this entire mode, choose Automatic mode. |  Default value: Automatic cooling and heating |
| 7 |  | Set On/Off function enable or disable: Display switches between "OFF" and "ena". You can enable or disable the Automatic mode adjustment by end user. |  Default value: Enable |
| 8 |  | Set 2 pipes or 4 pipes: Display switches between "Pno" and "2P". Select which number of pipes you want to use: 2 pipes or 4 pipes. If you have selected the 4 pipes, go directly to step #15. |  Default value: 2 pipe |
| 9 |  | Change over mode selection: Display switches between "COc" and "nc". Please select mode of change over between contact normally cool or contact normally heat or external sensor. Note: This selection will affect "TO1" and/or "Ct1" if they are set in change over mode. If normally cool "nc" is selected, heating mode will be activated upon closing of contact. If normally heat "nh" is selected, cooling mode will be activated upon closing of contact. If external sensor "tS" is selected, heating mode will be activated when temperature read by external sensor is above the Change Over Set Point temperature "tCo", and cooling mode will be activated when temperature read by external sensor is under "tCo", see step #10. If "tS" is not selected, go directly to step #12. |  Default value: Normally cool |
| 10 |  | Change over set point temperature: (If "tS" has been selected at step #9) Display switches between "tCo" and the change over set point temperature selected. Please select the change over set point temperature. Note: heating mode will be activated when temperature read by external sensor is above the change Over Set Point temperature "tCo", and cooling mode will be activated when temperature read by external sensor is under "tCo". |  Range: 10 to 40°C [50 to 104°F] Increment: 0.5°C [1°F] Default value: 24°C [75°F] |
| 11 |  | Change over temperature sensor Calibration: Display switches between "COs" and the temperature read by the change over temperature sensor (if connected). You can adjust the calibration of the change over sensor by comparison with a known thermometer. |  Range: 10 to 40°C [50 to 104°F] (max offset ± 5°C) Increment: 0.1°C [0.2°F] Display: 0°C [32°F], resistance will be infinite. 50°C [122°F], resistance will be short circuited. |

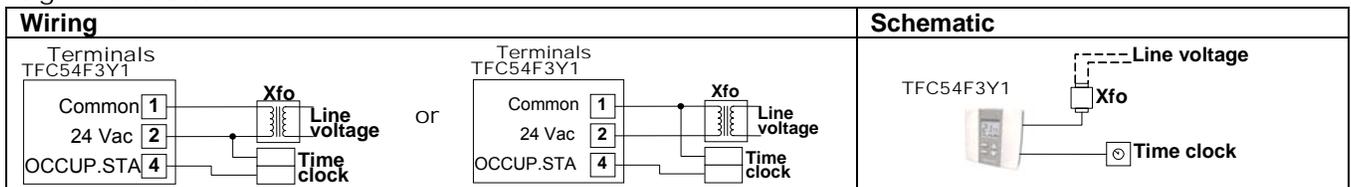
| Step | Display | Description | Values |
|------|---------|--|--|
| 12 | | <p>Set local reheat On/Off or TPM: If you have selected 2 pipe at step #8</p> <p>Display switches between "LHt" and "OFF". Select which signal output you want for TO2. You can choose OFF (no signal selected), ON heating only, ON heating & fan, PULSE heating only, PULSE heating & fan output.</p> <p>If you select OFF (no local reheat), go directly to step #17.</p> | <p>Default value: Off</p> |
| 13 | | <p>Proportional band for local reheat (TO2): Display switches between "Pb.L" and the value of the local reheat proportional band, heating symbol is also displayed. Please select the desired value of local reheat proportional band.</p> | <p>Proportional band range: 0.5 to 5.0°C [1.0 to 10.0°F] Increment: 0.5°C [1.0°F] Default value: 2.0°C [4.0°F]</p> |
| 14 | | <p>Dead band for local reheat (TO2): Display switches between "db.L" and the value of the local reheat dead band, heating symbols are also displayed. Please select the desired value of local reheat dead band. Go to step #17.</p> | <p>Proportional band range: 0.3 to 5.0°C [0.6 to 10.0°F] Increment: 0.1°C [0.2°F] Default value: 0.3°C [0.6°F]</p> |
| 15 | | <p>Internal/external temperature sensor selection: If you have selected 4 pipe control mode at step #8</p> <p>Display switches between "tS" and "in" or "out". Please select internal or external sensor. If you select internal sensor "in", go directly to step #17.</p> | <p>Default value: Internal temperature sensor</p> |
| 16 | | <p>External temperature sensor calibration: Display switches between "tS2" and the temperature read by the external temperature sensor (if connected). You can adjust the calibration of the external sensor by comparison with a known thermometer.</p> | <p>Range: 10 to 40°C [50 to 104°F] (max offset ± 5°C) Increment: 0.1°C [0.2°F] Display: 0°C [32°F], resistance will be infinite. 50°C [122°F], resistance will be short circuited.</p> |
| 17 | | <p>Proportional band 1 in heating: Display switches between "Pb.1" and the value of the 1st heating proportional band, heating symbol is also displayed. Please select the desired value of 1st heating proportional band.</p> | <p>Proportional band range: 0.5 to 5.0°C [1.0 to 10.0°F] Increment: 0.5°C [1.0°F] Default value: 2.0°C [4.0°F]</p> |
| 18 | | <p>Proportional band 1 in cooling: Display switches between "Pb.1" and the value of the 1st cooling proportional band, cooling symbol is also displayed. Please select the desired value of 1st cooling proportional band.</p> | <p>Proportional band range: 0.5 to 5.0°C [1.0 to 10.0°F] Increment: 0.5°C [1.0°F] Default value: 2.0°C [4.0°F]</p> |
| 19 | | <p>Dead band in heating: Display switches between "db.1" and the value of the dead band in heating, heating symbols are also displayed. Please select the desired value of dead band in heating.</p> | <p>Proportional band range: 0.3 to 5.0°C [0.6 to 10.0°F] Increment: 0.1°C [0.2°F] Default value: 0.3°C [0.6°F]</p> |
| 20 | | <p>Dead band in cooling: Display switches between "db.1" and the value of the dead band in cooling, cooling symbols are also displayed. Please select the desired value of dead band in cooling.</p> | <p>Proportional band range: 0.3 to 5.0°C [0.6 to 10.0°F] Increment: 0.1°C [0.2°F] Default value: 0.3°C [0.6°F]</p> |
| 21 | | <p>Set fan speed automatic mode enable or disable: Display switches between "FAn" and "ena". Fan symbol is also displayed. You can enable or disable the Automatic mode adjustment by end user. If you selected to disable the automatic mode, go directly to step #23.</p> | <p>Default value: Enable</p> |
| 22 | | <p>Time out fan contact: Display switches between "Fto" and the automatic shutoff delay value (in minutes) when there is no demand. MIN and fan symbol are also displayed. Please select the desired value of the automatic shutoff delay.</p> | <p>Range: 0 to 15 min. Increment: 1 min. Default value: 0 min.</p> |
| 23 | | <p>Fan speed contact: Display switches between "FAn" and "SPd" and the speed of the fan. Fan symbol is also displayed. Select which speed contact you want: speed 1, speed 2 or speed 3.</p> | <p>Default value: Hi speed (3)</p> |
| 24 | | <p>Delay cooling contact (protection for compressor): If you have selected 4 pipe at step #8 Display switches between "noc" and the value (in minutes) of the delay to activate / reactivate cooling contact. MIN and cooling symbols are also displayed. Please select the desired value of the delay cooling contact.</p> | <p>Range: 0 to 15 min. Increment: 1 min. Default value: 2 min.</p> |
| 25 | | <p>Night set back derogation time: Display switches between "nSb" and the derogation time in minute. MIN and NSB symbol is also displayed. Please select the desired derogation time. If you select "OFF", the thermostat is off when NSB is activated. If you select OFF, go directly to step #1.</p> | <p>Range: OFF or 00 to 180 min. Increment: 15min. Default value: 120 min.</p> |

| Step | Display | Description | Values |
|------|---|---|---|
| 26 |  | <p>Heating Set point during Night set back: Display switches between "Stp" and the value of the heating set point temperature during night set back. NSB) and heating symbols are also displayed. Please select the heating set point temperature during night set back. The minimum value is restricted by the maximum value (step #27)</p> |  <p>Range: 10 to 35°C [50 to 95°F] Increment: 0.5°C [1°F] Default value: 16°C [61°F]</p> |
| 27 |  | <p>Cooling Set point during Night set back: Display switches between "Stp" and the value of the cooling set point temperature during night set back. NSB) and cooling symbols are also displayed. Please select the cooling set point temperature during night set back. The maximum value is restricted by the minimum value (step #26)</p> |  <p>Range: 10 to 35°C [50 to 95°F] Increment: 0.5°C [1°F] Default value: 28°C [82°F]</p> |

Operation Mode

| Step | Description | Display |
|------|--|---------|
| A | <p>At powering up, thermostat will light display and activate all LCD segments during 2 seconds. Illuminating the LCD. To illuminate the LCD, you just have to push onto Δ or ∇ buttons. LCD will light for 8 seconds. Temperature display In operation mode, thermostat will automatically display temperature read. To change the scale between $^{\circ}\text{C}$ and $^{\circ}\text{F}$, press on both Δ and ∇ for 3 seconds.</p> | |
| B | <p>Set point display and adjustment: To display the set point, press two times on Δ or ∇. Set point will be displayed during 5 seconds. To adjust set point, press on Δ or ∇ while the temperature set point is displayed. <i>Note: If set point adjustment has been locked, symbol will be displayed.</i></p> | |
| C | <p>Night set back (NSB): When thermostat is in night set back mode, NSB \curvearrowright symbol is displayed, so set point for cooling and/or heating are increased as per the setting made in programming mode. If not locked, night set back can be derogated for a predetermined period by pressing onto any of the 4 buttons. During period of NSB derogation the \curvearrowright symbol will flash. If NSB does not flash, the derogation period is finished or the Night set back derogation has been locked in programming mode.</p> | |
| D | <p>Control mode selection : To change the control mode, press on . Control mode will be displayed during 5 seconds. You can choose one of the following: ✓ Automatic Cooling or Heating ✓ Cooling and Heating OFF ✓ Cooling only ✓ Heating only Note: These selections can vary according to the choice made on step #6 & 7.</p> | |
| E | <p>Fan speed mode selection: To change the fan speed mode, press on . Fan speed mode will be displayed during 5 seconds. You can choose one of the following: ✓ Automatic speed ✓ Low speed ✓ Medium speed ✓ High speed Note: These selections can vary according to the choice made on step #21 & #23.</p> | |

Night set back



Notes:

Recycling at end of life



At end of life, please return the thermostat to your Neptronic[®] local distributor for recycling. If you need to find the nearest Neptronic[®] authorized distributor, please consult www.neptronic.com.